


“INSTRUCCIONES DE MONTAJE NETVITC SYSTEM®”

PARA UN CORRECTO MONTAJE DEL SISTEMA NETVITC SYSTEM® SE DEBEN REALIZAR LOS SIGUIENTES PASOS:

- 1.-Colocar la junta bilabial **Netvitc System®** en la cara exterior del accesorio.
- 2.-Presentar los elementos **Netvitc System®** uno frente a otro siempre que la medida de la brida sea común.
- Por ejemplo: codo “Air” **Netvitc System® Ø90** con **Válvula de Mariposa Netvitc System® Ø90**.
- 3, 4 y 5.-Colocar brida **Netvitc System®** INFERIOR entre alojamientos del sistema y a continuación la brida SUPERIOR.
- 6.-Colocar tornillería y apretar de manera alterna y progresiva los tornillos, de forma que la brida quede equilibrada.

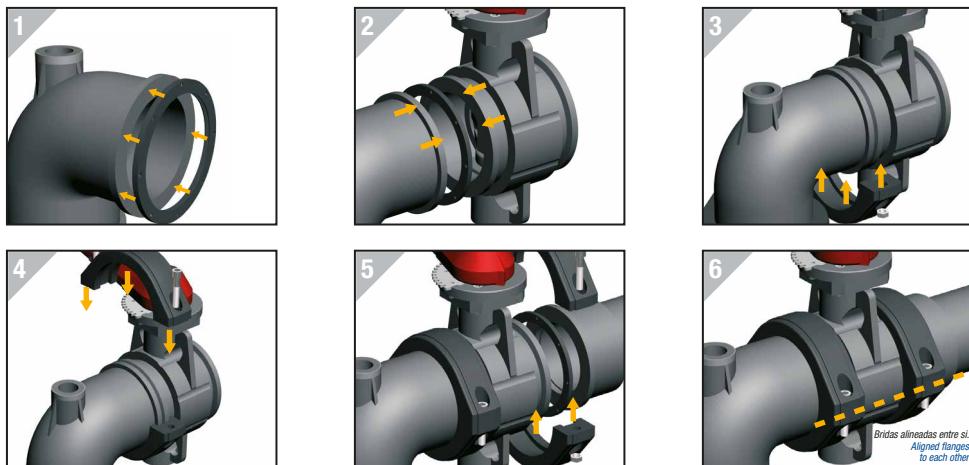

Ejemplo: Montaje codo 90° AIR Netvitc System® con válvula de mariposa Netvitc System®.

Example: assembling a 90° Netvitc System® “Air” elbow with a Netvitc System® butterfly valve.

NOTA:

Los elementos Netvitc System® podrán combinarse aunque tengan diferentes diámetros siempre que tengan la brida en común, por ejemplo, la válvula de mariposa Netvitc System® de Ø125 podrá combinarse con válvulas de retención lineal (DN 100) al tener la brida en común.

Por su sistema de enlace Netvitc System®, para un correcto desmontaje es imprescindible que la instalación de la tubería permita una movilidad suficiente para extraer la junta y facilitar posteriores operaciones de montaje y desmontaje.



MODELO JUNTA “J-BIL” NETVITC SYSTEM®
NETVITC SYSTEM O-RING MODEL “J-BIL”
Con alma de Acero Inoxidable en su interior

“SYSTEM OF ASSEMBLING NETVITC SYSTEM®”

Please follow the points below to get a correct mounting.

- 1.-Place the double lipped joint in the outside part of the fitting.
- 2.-Situate the NETVITC SYSTEM® parts face to face, the measure of the flange must always be common.
- 3, 4 and 5.-Place the lower NETVITC SYSTEM® flange between the bedding of the system and then the upper flange.
- 6.-Position the screws, tight them up in a gradual and alternative way in order to keep the flange balanced.

NOTE:

The NETVITC SYSTEM® parts could be combined even if they have different diameters, considering they have the flange in common. For example, NETVITC SYSTEM® butterfly valve Ø125 could be combined with a NETVITC SYSTEM® lineal check valve with a flange in common.

With its NETVITC SYSTEM® coupling, for a correct mounting it is essential the installation of the pipe have enough mobility to blow off the joint and allow future assembling and disassembling operations.